


**PLACE THIS LABEL ON AIR HANDLER CLOSE TO TRAP**

**CLEANING INSTRUCTIONS FOR ALL MODEL 100, 200 & 300 SERIES EZ-TRAP**


(Not applicable to Model 150, 160, 250 & 260)

**For optimum performance trap & drain pan outlet should be cleaned at regular intervals, particularly during summer.**


1. Open Upper Red Cap - **A** (100 series) or remove Black Float Switch Assembly - **B** (200 series).




2. Insert Brush into open top of cross, push down through trap, then remove.



3. Open Lower Red Cap - **C**, and insert Brush so that it goes right into drain pan inside A/C unit, then remove.




4. Replace Lower Red Cap - **C**. MUST BE AIRTIGHT. Do not test until this Cap is closed.

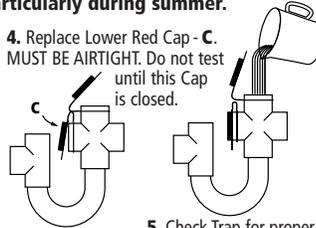

5. Check Trap for proper operation by pouring water into opening.

6. Replace Upper Red Cap - **A** (100 series) or Black Float Switch Assembly - **B** (200 series). These are essential for correct operation of trap & must remain fitted during normal operation.



**INSTALLER NOTE:** THIS TRAP MUST BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS TO ENSURE PROPER OPERATION, AND IN ACCORDANCE WITH ALL LOCAL PLUMBING, DRAINAGE AND/OR ELECTRICAL CODES.

Manufactured & Dist. by: **EZ-TRAP INC.**, 3 Kellogg Court, Unit 10, Edison, NJ 08817  
tel: 732-248-8066 • fax: 732-248-8068 • e-mail: info@eztrap.com • web site: www.eztrap.com